

On-site Wastewater Management Training Course

Evapotranspiration Systems and Sizing by Water Balance

Centre for Environmental Training 

Terminology

Evapotranspiration Systems referred to as:

- Evapotranspiration Absorption Systems ETA – Australia (unlined)
- Evapotranspiration Seepage Systems ETS – New Zealand (unlined)
- Or simply Evapotranspiration Systems ET, if lined

Centre for Environmental Training 

Purpose

ETA/S Systems designed to:

- Maximise evapotranspiration
- Reduce absorption (drainage) in unlined systems
- Avoid absorption in lined systems
- Provide alternative to conventional trenches/beds in areas of low permeability soils (<0.5-1.5 m/d) e.g. clay loams, light, medium and heavy clays

Centre for Environmental Training 

AS/NZS1547:2012

- Table L1 gives recommended DLRs of between 12 mm/d (CL) and 5 mm/d (LC/MC) based on soil texture
- Not necessary for annual evaporation to exceed annual precipitation
- Can use plant transpiration and void space storage to manage hydraulic load throughout seasons

Centre for Environmental Training 

AS/NZS1547:2012

- DLRs are conservative values
- Any variation to be justified by full water balance for 12-month cycle (Appendix Q)
- No higher DLRs for Secondary treated effluent (may be better to use conventional trench or bed)
- Plant with grasses and shrubs which tolerate wet conditions and have high evapotranspiration capacity
- Construction outlined in Appendix L

Centre for Environmental Training 

Water Balance Design

- Background outlined in Appendix Q in AS/NZS1547:2012
- Main factors:
 - Effluent largely disposed of through deep infiltration, interflow and evapotranspiration
 - Evapotranspiration is significant but may not dominate water balance
 - Some deep infiltration is required to prevent salt build up
 - Not suited to shallow water tables unless using a lined system

Centre for Environmental Training 


Important Components of ET Bed Design

- Crop Factors (Cf), Evaporation (E) and Evapotranspiration (ET) – explained further in water balance example later
- Capillary Water – movement of water laterally and upwards under surface tension
- Field Capacity (FC) – upper limit of available water storage in soil / medium
- Void Ratio (n) – proportion of bed available for water/air storage

Centre for Environmental Training



AS/NZS1547:2012 ETA Bed Design Detail

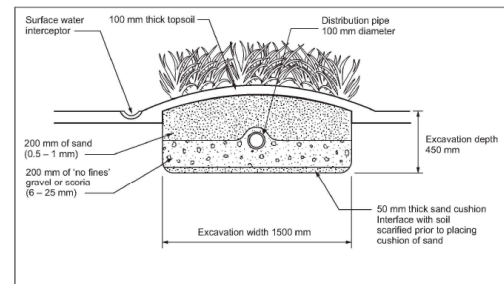


(Source: Standards Australia 2012)

Centre for Environmental Training



'Typical' ETA Bed Layout

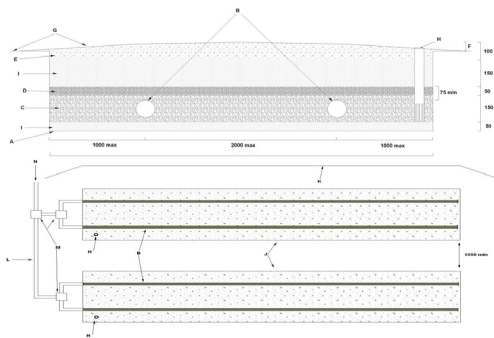

Centre for Environmental Training



ETA Bed Installed



Centre for Environmental Training



Raised ETA Bed



Centre for Environmental Training



Consideration of Climatic Data

- Pan evaporation (E)
 - From nearest climatically similar meteorological station
- Rainfall (R)
 - From nearest climatically similar meteorological station
- Or use SILO data:
- <https://www.longpaddock.qld.gov.au/silo/>

Centre for Environmental Training




'Class A' Evaporation Pan



Total historical station coverage nationwide:


- 17,875 rainfall stations
- Only 601 evaporation stations



(Source: BoM) Centre for Environmental Training cet

'Class A' Evaporation Pan

- Diminishing number of evaporation stations
- Move to SILO data (5km x 5km intersections)

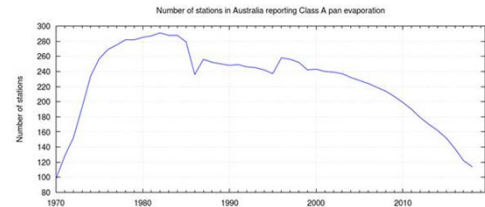

(Source: BoM)


Centre for Environmental Training cet

Nominal Monthly Area Requirement

Month	Pan evaporation E mm	Evapotranspiration ET ET=0.75E mm	Rainfall R mm	Retained rainfall R _r =R-0.75R mm	LTAR per month mm	Disposal rate per month mm	Effluent applied per month L	Size of area m ²
Jan	207.7	155.8	109	81.75	0	74.01	27900	376.90
Feb	170.8	128.1	119	89.25	0	38.85	25200	648.65
Mar	151.9	113.9	122	91.50	0	22.43	27900	1244.15
Apr	114.0	85.5	105	78.75	0	6.75	27000	4000.00
May	77.5	58.1	105	78.75	0	-20.63	27900	-1352.73
Jun	75.0	56.3	121	90.75	0	-34.50	27000	-782.61
Jul	80.6	60.5	69	51.75	0	8.70	27900	3206.90
Aug	108.5	81.4	84	63.00	0	18.38	27900	1518.37
Sep	141.0	105.8	59	44.25	0	61.50	27000	439.02
Oct	167.4	125.6	82	61.50	0	64.05	27900	435.60
Nov	192.0	144.0	76	57.00	0	87.00	27000	310.34
Dec	232.5	174.4	80	60.00	0	114.38	27900	243.93

Table 3. Calculation of area for each month (disregarding storage of effluent).
Centre for Environmental Training cet

Inputs (Re) vs. Outputs (ET)

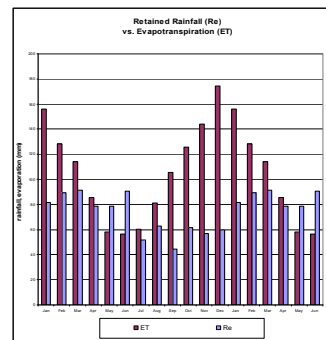

- ET dominates the WB, but not completely
- Excess rainfall can be managed for periods of the year provided that there is storage available in the system

Centre for Environmental Training cet

Depth of Stored Effluent

Month	First total area m ²	Application rate (3) mm	Disposal rate per month (4) mm	(3) - (4) mm	Increase in depth of stored effluent mm	Depth of effluent for month (X - 1) mm	Increase in depth of effluent mm	Computed depth of effluent (X) mm
Dec	1000							
Jan		27.9	74.01	-46.11	-153.70	0	+ -153.70	= 0
Feb		25.2	38.85	-13.65	-45.50	0	+ -45.50	= 0
Mar		27.9	22.43	5.47	18.23	0	+ 18.23	= 18.23
Apr		27.0	6.75	20.25	67.50	18.23	+ 67.50	= 85.73
May		27.9	-20.63	48.53	161.77	85.73	+ 161.77	= 247.50
Jun		27.0	-34.50	61.50	205.00	247.50	+ 205.00	= 452.50
Jul		27.9	8.70	19.20	64.00	452.50	+ 64.00	= 516.50
Aug		27.9	18.38	9.52	31.73	516.50	+ 31.73	= 548.23
Sep		27.0	61.50	-34.50	-115.00	548.23	+ -115.00	= 433.23
Oct		27.9	64.05	-36.15	-120.50	433.23	+ -120.50	= 312.73
Nov		27.0	87.00	-60.00	-200.00	312.73	+ -200.00	= 112.73
Dec		27.9	114.38	-86.48	-288.27	112.73	+ -288.27	= 0

Table 4. Depth of stored effluent.

Centre for Environmental Training cet

The Use of Water Balances

- Will work through an example of an unlined ETA bed
- Have provided templates for water balances for beds and also irrigation areas
- Once you have practiced the skills required in doing water balances longhand they lend themselves to setting up spreadsheets to speed calculation

Centre for Environmental Training cet

Water Balance Exercise

- Calculate the minimum area and depth of an evapotranspiration-absorption/seepage area for a three bedroom / five person dwelling
- BoM rainfall (Mornington) and pan evaporation data (Melbourne Airport)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Mean Monthly rainfall (mm)	44.3	42.6	48.7	62.3	70	71.6	68.5	71.1	71	68.9	60.8	53.5
Mean Daily Evaporation (mm)	8.1	7	5.7	3.8	2.5	1.8	2	2.7	4	5.2	6	7.4

Water Balance Exercise

- Three test pits excavated on the proposed disposal area indicate that the soils are 475 mm weakly structured clay loam overlying moderately structured light clay to a depth of 2,000 mm. Use the recommended design loading rate derived from Table L1 of AS/NZS1547:2012 (see the Field Workshop and Design Exercise section of these Course Notes)

Water Balance Exercise

- Calculate the evapotranspiration-absorption/seepage area using the worksheets provided on the following pages
- The evapotranspiration-absorption area is to be constructed of imported aggregate, is to have a maximum depth of 400 mm with a minimum of 50 mm freeboard (i.e. maximum depth of stored effluent is 350 mm)
- Conventional beds may have between 300 mm and 600 mm of aggregate, ETA/ETS beds 400 mm of aggregate and sand

Calculation of evapotranspiration-absorption area size by water balance method

Size of area for each month

(1) Month	(2) Pan evaporation E mm	(3) Evapo transpiration ET ET = 0.75E mm	(4) Rainfall R mm	(5) Retained rainfall R _r R _r = 0.75R mm	(6) DLR per month mm	(7) Disposal rate per month (3)-(5)+(6) mm	(8) Effluent applied per month L	(9) Size of area (8)/(7) m ²
Jan								
Feb								
Mar								
Apr								
May								
Jun								
Jul								
Aug								
Sep								
Oct								
Nov								
Dec								
First trial area = average monthly area =								m ²

Depth of stored effluent (first trial)

(1) Month	(2) First trial area m ²	(3) Application rate (8)/(2) mm	(4) Disposal rate per month (7) mm	(5) (3) - (4) mm	(6) Increase in depth of stored effluent (5)/n mm	(7) Depth of effluent for month (X - 1) mm	(7) Increase in depth of effluent + (6) mm	Computed depth of effluent month (X) mm
Dec						0		
Jan								
Feb								
Mar								
Apr								
May								
Jun								
Jul								
Aug								
Sep								
Oct								
Nov								
Dec								

n = effective void space factor. For imported durable aggregate, n = 0.3

Conclusions and Discussion

- Can use water balances to size/check size of all land application areas
- Previous example of unlined bed
- Slight modification for lined bed or trench (LTAR/DLR = 0)
- Similar water balance used for sizing irrigation areas but considers soil as an infinitely thin store (i.e. no soil storage) for conservative sizing

References

- Patterson RA, (2006). Evapotranspiration Bed Designs for Inland Areas. Septic Safe Technical Sheet Reference 05/15. NSW Department of Local Government, July 2006

Month	Pan evaporation E mm	Evapotranspiration ET ET=0.75E mm	Rainfall R mm	Retained rainfall $R_r = 0.75R$ mm	LTAR per month mm	Disposal rate per month mm	Effluent applied per month L	Size of area m ²
Jan	207.7	155.8	109	81.75	0	74.01	27900	376.90
Feb	170.8	128.1	119	89.25	0	38.85	25200	648.65
Mar	151.9	113.9	122	91.50	0	22.43	27900	1244.15
Apr	114.0	85.5	105	78.75	0	6.75	27000	4000.00
May	77.5	58.1	105	78.75	0	-20.63	27900	-1352.73
Jun	75.0	56.3	121	90.75	0	-34.50	27000	-782.61
Jul	80.6	60.5	69	51.75	0	8.70	27900	3206.90
Aug	108.5	81.4	84	63.00	0	18.38	27900	1518.37
Sep	141.0	105.8	59	44.25	0	61.50	27000	439.02
Oct	167.4	125.6	82	61.50	0	64.05	27900	435.60
Nov	192.0	144.0	76	57.00	0	87.00	27000	310.34
Dec	232.5	174.4	80	60.00	0	114.38	27900	243.93

Table 3. Calculation of area for each month (disregarding storage of effluent).

Month	First trial area m ²	Applica- tion rate (3) mm	Disposal rate per month (4) mm	(3) - (4) mm	Increase in depth of stored effluent mm	Depth of effluent for month (X - 1) mm	Increase in depth of effluent mm	Compu- ted depth of effluent month (X) mm
Dec	1000							
Jan		27.9	74.01	-46.11	-153.70	0	+ -153.70	= 0
Feb		25.2	38.85	-13.65	-45.50	0	+ -45.50	= 0
Mar		27.9	22.43	5.47	18.23	0	+ 18.23	= 18.23
Apr		27.0	6.75	20.25	67.50	18.23	+ 67.50	= 85.73
May		27.9	-20.63	48.53	161.77	85.73	+ 161.77	= 247.50
Jun		27.0	-34.50	61.50	205.00	247.50	+ 205.00	= 452.50
Jul		27.9	8.70	19.20	64.00	452.50	+ 64.00	= 516.50
Aug		27.9	18.38	9.52	31.73	516.50	+ 31.73	= 548.23
Sep		27.0	61.50	-34.50	-115.00	548.23	+ -115.00	= 433.23
Oct		27.9	64.05	-36.15	-120.50	433.23	+ -120.50	= 312.73
Nov		27.0	87.00	-60.00	-200.00	312.73	+ -200.00	= 112.73
Dec		27.9	114.38	-86.48	-288.27	112.73	+ -288.27	= 0

Table 4. Depth of stored effluent.

WATER BALANCE ANALYSIS WORKSHOP SESSION

Calculation of evapotranspiration-absorption/seepage area size by the water balance method.

Using the following information using your Course Notes, calculate the minimum area and depth of an evapotranspiration-absorption/seepage area for a three bedroom / five person dwelling.

Bureau of Meteorology rainfall (Mornington) and pan evaporation (Melbourne Airport) data is provided below.

	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC
DAILY PAN EVAPORATION (mm)	8.1	7.0	5.7	3.8	2.5	1.8	2.0	2.7	4.0	5.2	6.0	7.4
MEAN MONTHLY RAINFALL (mm)	44.3	42.6	48.7	62.3	70.0	71.6	68.5	71.1	71.0	68.9	60.8	53.5

Three test pits excavated on the proposed disposal area indicate that the soils are 475 mm weakly structured clay loam overlying moderately structured light clay to a depth of 2,000 mm. Use the recommended design loading rate derived from Table L1 of AS/NZS1547:2012 (see the Field Workshop and Design Exercise section of these Course Notes).

Calculate the evapotranspiration-absorption/seepage area using the worksheets provided on the following two pages.

The evapotranspiration-absorption area is to be constructed of imported aggregate, is to have a maximum depth of 400 mm with a minimum of 50 mm freeboard (i.e. maximum depth of stored effluent is 350 mm).

Calculation of evapotranspiration-absorption area size by water balance method

Size of area for each month

(1) Month	(2) Pan evaporation E mm	(3) Evapo transpiration ET ET = 0.75E mm	(4) Rainfall R mm	(5) Retained rainfall $R_r = 0.75R$ mm	(6) DLR per month mm	(7) Disposal rate per month $(3)-(5)+(6)$ mm	(8) Effluent applied per month L	(9) Size of area $(8)/(7)$ m^2
Jan								
Feb								
Mar								
Apr								
May								
Jun								
Jul								
Aug								
Sep								
Oct								
Nov								
Dec								
First trial area = average monthly area =								m^2

Depth of stored effluent (first trial)

(1) Month	(2) First trial area m ²	(3) Application rate (8)/(2) mm	(4) Disposal rate per month (7) mm	(5) (3) - (4) mm	(6) Increase in depth of stored effluent (5)/n mm	Depth of effluent for month (X - 1) mm	(7) Increase in depth of effluent + (6) mm	Computed depth of effluent month (X) mm
Dec		-	-	-	-	0		
Jan								
Feb								
Mar								
Apr								
May								
Jun								
Jul								
Aug								
Sep								
Oct								
Nov								
Dec								

n = effective void space factor. For imported durable aggregate, n = 0.3

Minimum Area Method Water Balance and Wet Weather Storage Calculations

Design Wastewater Flow	(Q)	L/day																			
Design Percolation Rate	(R)	mm/wk																			
Parameter	Symbol	Formula	Units	J	F	M	A	M	J	J	A	S	O	N	D	Total					
Days in month	(D)	-	day's																		
Precipitation	(P)	-	mm/month																		
Evaporation	(E)	-	mm/month																		
Crop factor	(C)	-	-																		
Outputs																					
Evapotranspiration	(ET)	E x C	mm/month																		
Percolation	(B)	(R/7) x D	mm/month																		
Outputs		(ET+B)	mm/month																		
Inputs																					
Precipitation	(P)	-	mm/month																		
Possible Effluent Irrigation	(W)	(ET + B) - P	mm/month																		
Actual Effluent Production	(I)	H/12	mm/month																		
Inputs		(P + I)	mm/month																		
Storage	(S)	(P+I) - (ET+B)	mm/month																		
Cumulative storage	(M)	-	mm																		
Irrigation Area																					
	(L)	365 x Q/H	m ²																		
Storage																					
	(V)	largest M (V x L)/1000	mm m ³																		

Monthly Water Balance used to Determine Wet Weather Storage for a Medium Rainfall Region with a Nominated Irrigation Area

Design Wastewater Flow	(Q)	L/day																		
Design Percolation Rate	(R)	mm/wk																		
Land Area	(L)	m ²																		
Parameter	Symbol	Formula	Units	J	F	M	A	M	J	J	A	S	O	N	D	Total				
Days in month	(D)	-	days																	
Precipitation	(P)	-	mm/month																	
Evaporation	(E)	-	mm/month																	
Crop factor	(C)	-	-																	
Inputs																				
Precipitation	(P)	-	mm/month																	
Effluent Irrigation	(W)	(Q x D)/L	mm/month																	
Inputs		(P+W)	mm/month																	
Outputs																				
Evapotranspiration	(ET)	E x C	mm/month																	
Percolation	(B)	(R/7) x D	mm/month																	
Outputs		(ET+B)	mm/month																	
Storage	(S)	(P+W) - (ET+B)	mm/month																	
Cumulative storage	(M)	-	mm																	
Storage	(V)	largest M	mm																	
		(V x L)/1000	m³																	